


LANDSCAPE IRRIGATION SYSTEM

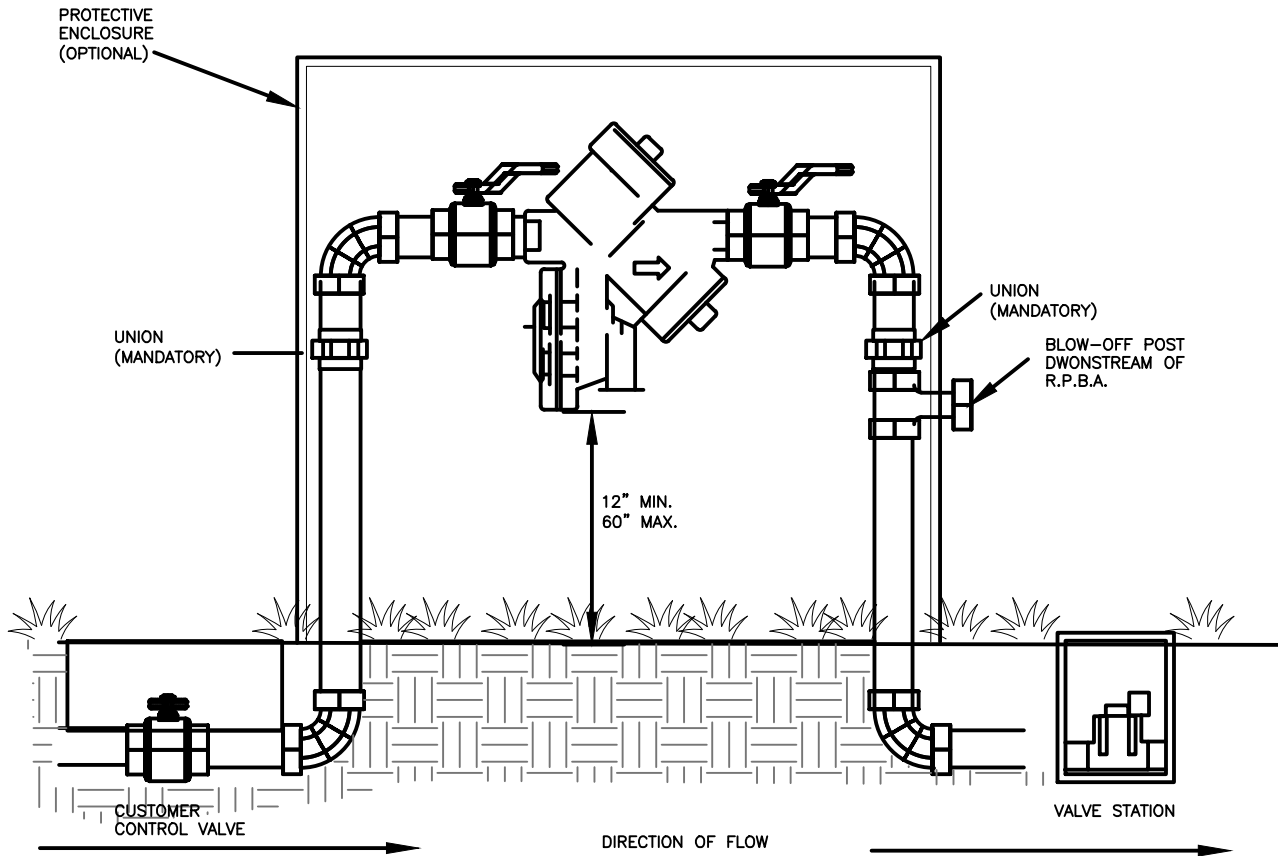

NOTES:

A.W.W.A. MANUAL OF WATER SUPPLY PRACTICES M14:

AN RP MUST NOT BE INSTALLED IN A PIT OR BELOW GRADE WHERE THE RELIEF VALVE COULD BE SUBMERGED IN WATER OR WHERE FUMES COULD BE PRESENT AT THE RELIEF-VALVE DISCHARGE, BECAUSE THIS INSTALLATION MAY ALLOW WATER OR FUMES TO ENTER THE ASSEMBLY.

AN R.P.B.A. MAY PERIODICALLY DISCHARGE WATER FROM THE RELIEF VALVE. IF THE RP DISCHARGE IS PIPED TO A DRAIN, AN AIR-GAP SEPARATION MUST BE INSTALLED AT THE RELIEF VALVE.

NOT TO SCALE

	East Greenacres Irrigation District	Approved by: <i>R. White</i>
	Reduced Pressure Backflow Assembly	District Manager
		5/15/18 Date
		Standard Drawing No. W-13